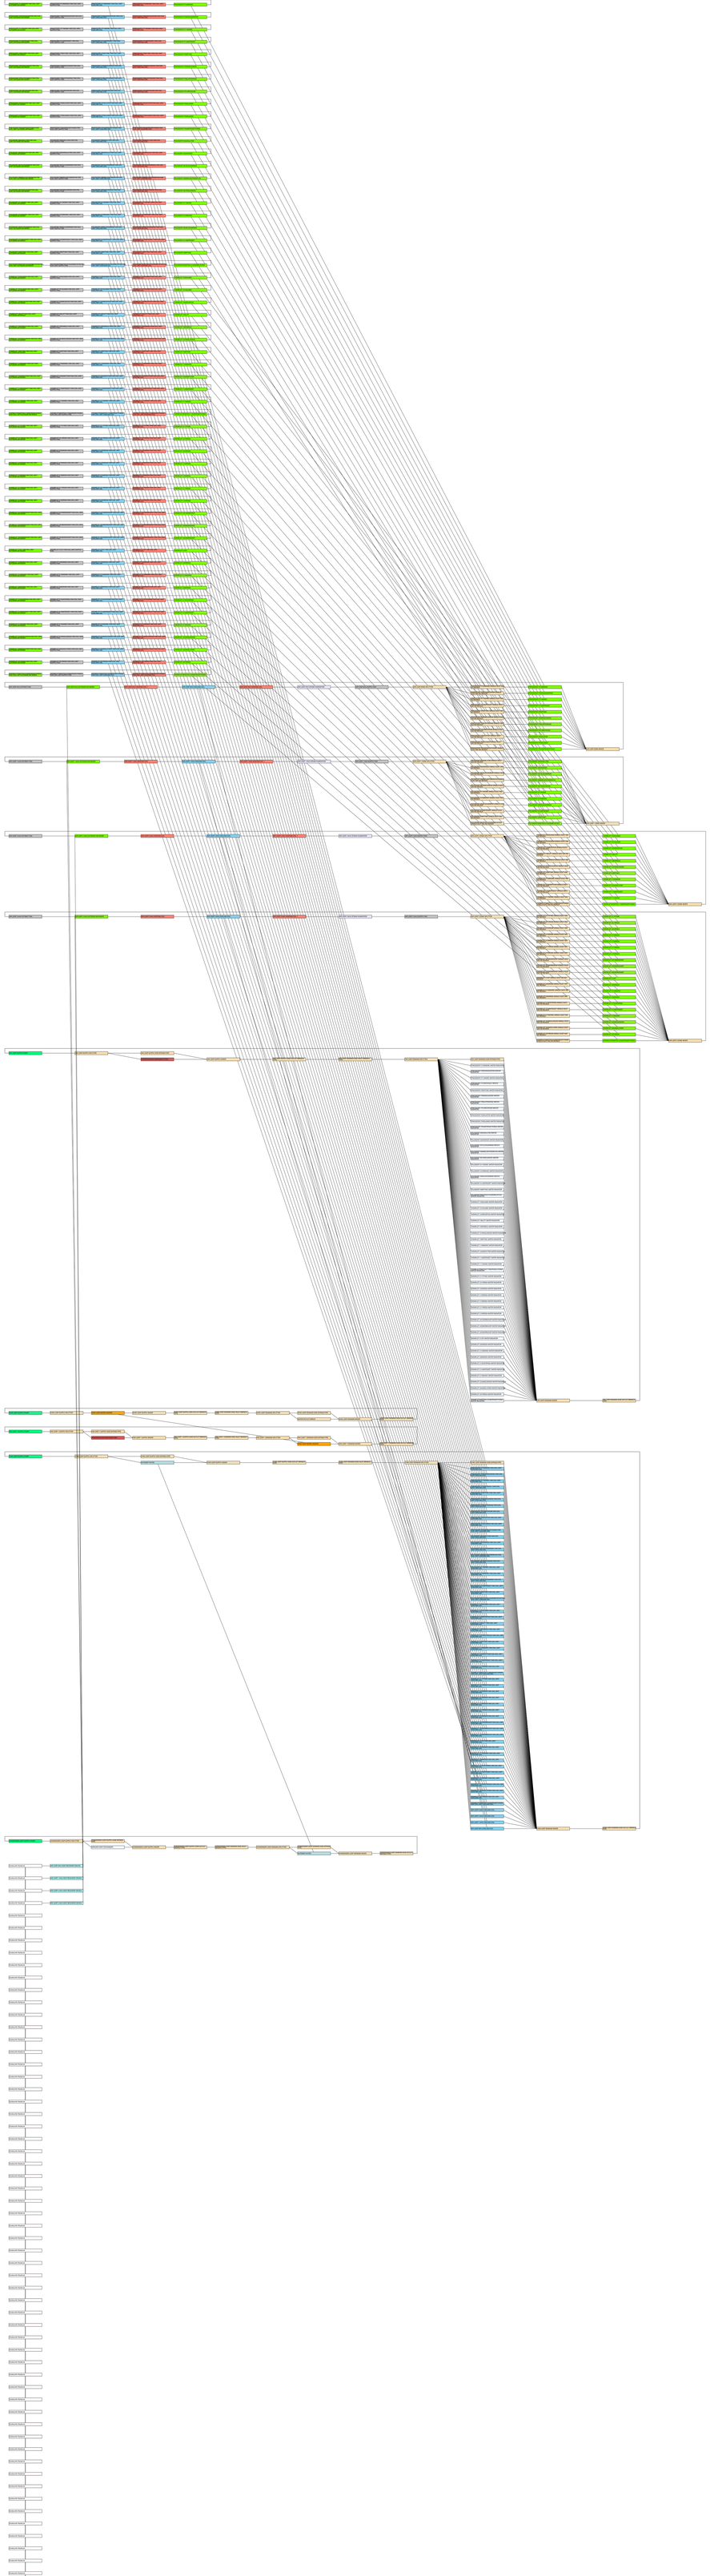

17. sz. melléklet

Az elektromos fűtőkaloriferű légkezelővel módosított referenciaépület épületgépészeti EnergyPlus kapcsolási rajza

Unused Non-Parent Objects:

AIR LOOP AHU HEAT RECOVERY DEVICE SETPOINT MANAGER
AIR LOOP 1 AHU HEAT RECOVERY DEVICE SETPOINT MANAGER
AIR LOOP 2 AHU HEAT RECOVERY DEVICE SETPOINT MANAGER
AIR LOOP 3 AHU HEAT RECOVERY DEVICE SETPOINT MANAGER
CHW LOOP SETPOINT MANAGER
HW LOOP SETPOINT MANAGER
DHW LOOP SETPOINT MANAGER
HW LOOP 1 SETPOINT MANAGER
AIR LOOP AHU OUTDOOR AIR SYSTEM MIXED AIR MANAGER
AIR LOOP AHU HEATING COIL 1 MIXED AIR MANAGER
AIR LOOP AHU COOLING COIL MIXED AIR MANAGER
AIR LOOP AHU HEATING COIL MIXED AIR MANAGER
AIR LOOP 1 AHU OUTDOOR AIR SYSTEM MIXED AIR MANAGER
AIR LOOP 1 AHU HEATING COIL MIXED AIR MANAGER
AIR LOOP 1 AHU COOLING COIL MIXED AIR MANAGER
AIR LOOP 1 AHU HEATING COIL 1 MIXED AIR MANAGER
AIR LOOP 2 AHU OUTDOOR AIR SYSTEM MIXED AIR MANAGER
AIR LOOP 2 AHU HEATING COIL MIXED AIR MANAGER
AIR LOOP 2 AHU COOLING COIL MIXED AIR MANAGER
AIR LOOP 2 AHU HEATING COIL 1 MIXED AIR MANAGER
AIR LOOP 3 AHU OUTDOOR AIR SYSTEM MIXED AIR MANAGER
AIR LOOP 3 AHU HEATING COIL MIXED AIR MANAGER
AIR LOOP 3 AHU COOLING COIL MIXED AIR MANAGER
AIR LOOP 3 AHU HEATING COIL 1 MIXED AIR MANAGER
AIR LOOP SETPOINT MANAGER
AIR LOOP 1 SETPOINT MANAGER
AIR LOOP 2 SETPOINT MANAGER
AIR LOOP 3 SETPOINT MANAGER
AIR LOOP SETPOINT MANAGER 5
AIR LOOP 1 SETPOINT MANAGER 5
AIR LOOP 2 SETPOINT MANAGER 5
AIR LOOP 3 SETPOINT MANAGER 5
AIR LOOP SETPOINT MANAGER 1
AIR LOOP 1 SETPOINT MANAGER 1
AIR LOOP 2 SETPOINT MANAGER 1
AIR LOOP 3 SETPOINT MANAGER 1
AIR LOOP SETPOINT MANAGER 6
AIR LOOP 1 SETPOINT MANAGER 6
AIR LOOP 2 SETPOINT MANAGER 6
AIR LOOP 3 SETPOINT MANAGER 6
CONDENSER LOOP SETPOINT MANAGER
AIR LOOP AHU COOLING COIL CONTROLLER
AIR LOOP 1 AHU COOLING COIL CONTROLLER
AIR LOOP 2 AHU COOLING COIL CONTROLLER
AIR LOOP 3 AHU COOLING COIL CONTROLLER
AIR LOOP AHU OUTDOOR AIR CONTROLLER
AIR LOOP 1 AHU OUTDOOR AIR CONTROLLER
AIR LOOP 2 AHU OUTDOOR AIR CONTROLLER
AIR LOOP 3 AHU OUTDOOR AIR CONTROLLER

The following are not supported: objects related to controls or ZoneHVAC:IdealLoadsAirSystem